


SHUT OFF VALVE MUST BE INSTALLED AT FACILITY OR LINE



TYPICAL SECTIONAL VIEW PRESSURIZED PIPELINE AND FOUNTAIN NOT TO SCALE

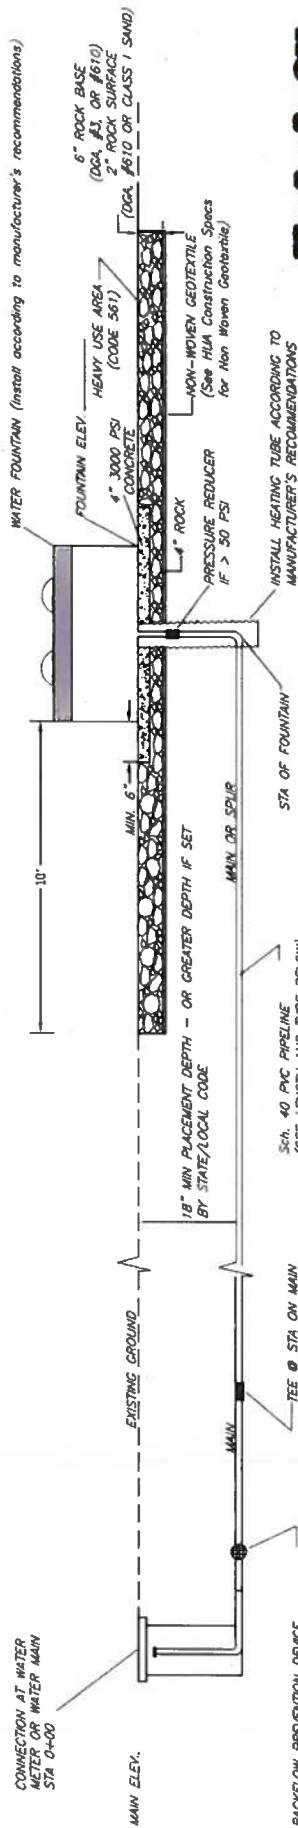